

PRODUCT BPC 5mg + TB 5mg
LOT NUMBER PBL-24123
TESTING LABORATORY Aegis Bioanalytical Laboratories - independent
ACCREDITATION ISO/IEC 17025 · San Diego, CA
MFG / EXPIRY Mar 1, 2026 / Feb 29, 2028
REPORT ISSUED Jul 12, 2026



SCAN TO VERIFY

REPORT ID AEG-0BTDKJA

Verify authenticity at localhost:3060/verify

METHODS RP-HPLC - purity · ESI-MS - identity · ICP-MS - heavy metals · LAL - endotoxin

TEST RESULTS


TEST	RESULT	SPECIFICATION	STATUS
Appearance	White lyophilized powder	Conforms	PASS
Identity - ESI-MS	Conforms (found)	Conforms (theoretical)	PASS
Purity - RP-HPLC	99.1%	$\geq 98.0\%$	PASS
Net peptide content	91%	$\geq 80\%$	PASS
Single impurity (max)	0.34%	$\leq 1.0\%$	PASS
Water content (Karl Fischer)	3.1%	$\leq 8.0\%$	PASS
Acetate content	7.7%	$\leq 15\%$	PASS
Heavy metals (ICP-MS)	Pb/As/Cd/Hg < 1 ppm	≤ 10 ppm	PASS
Bacterial endotoxin (LAL)	< 3.4 EU/mg	≤ 10 EU/mg	PASS
Bioburden	Not detected	< 10 CFU/vial	PASS

Authorized signatory, Quality Assurance
Aegis Bioanalytical · Analytical Services

RP-HPLC CHROMATOGRAM

Column: C18, 4.6 x 150 mm, 3.5 μ m · Gradient 0.1% TFA / acetonitrile · Detection 214 nm

Response (mAU)

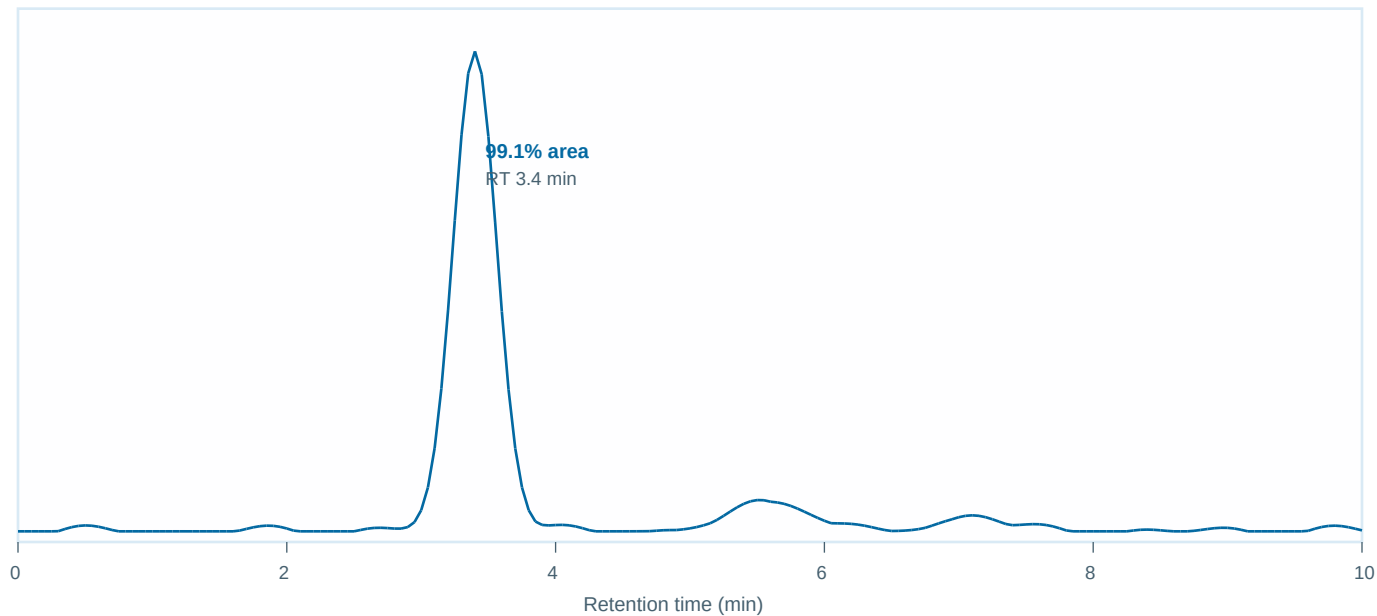

PEAK INTEGRATION

Main peak (target)	RT 3.4 min · 99.1% area
Related substances	< 1.0% total · largest single < 0.5%
ESI-MS identity	Conforms (found) vs Conforms (theoretical)